



MAGNA1

VALID FROM MODEL C

Further product
documentation





net.grundfos.com/qr/i/99209952



MAGNA1



MAGNA1 D

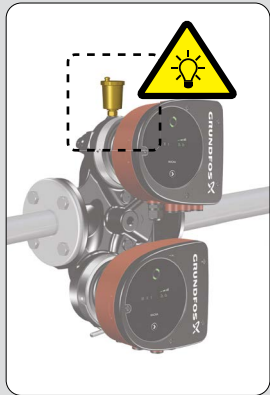





MAGNA1 F



MAGNA1 D F

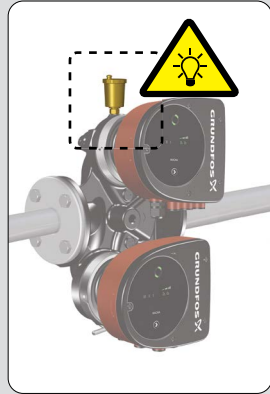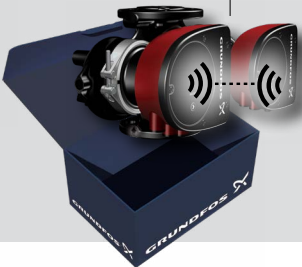



Min. / Max.
-10 °C / +110 °C



PN 6: 6 bar / 0.6 MPa
PN 10: 10 bar / 1.0 MPa
PN 16: 16 bar / 1.6 MPa



Min. / Max.
0 °C / +40 °C






< 39 dB(A)





Max. 95 % RH
IPX4D








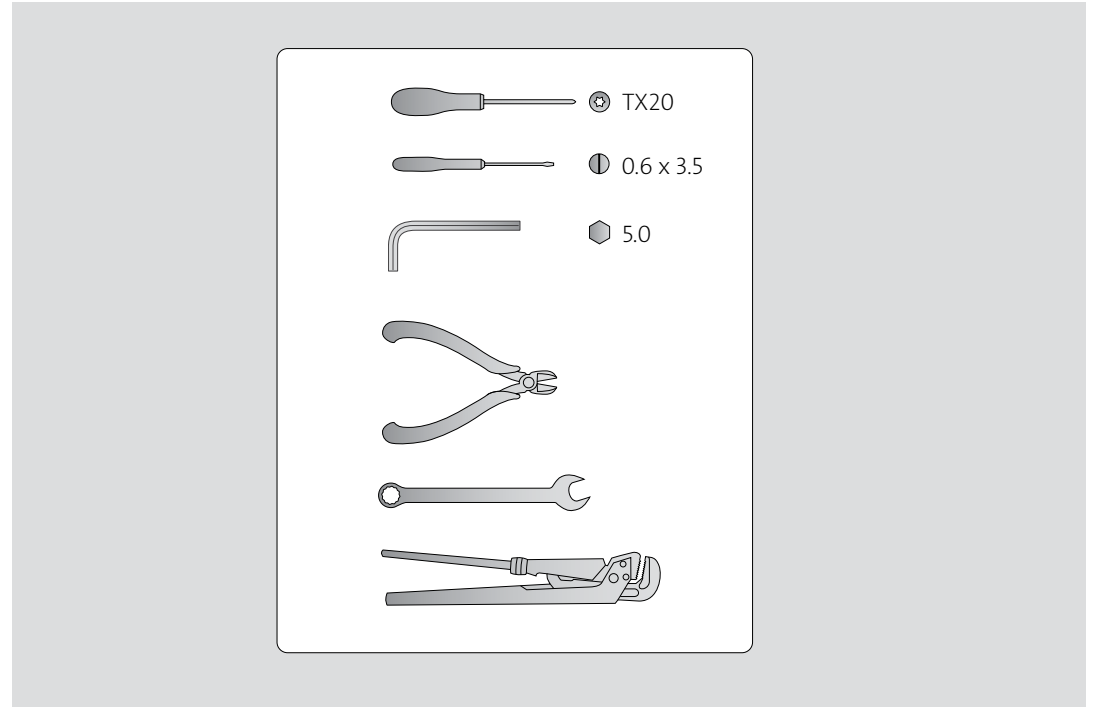
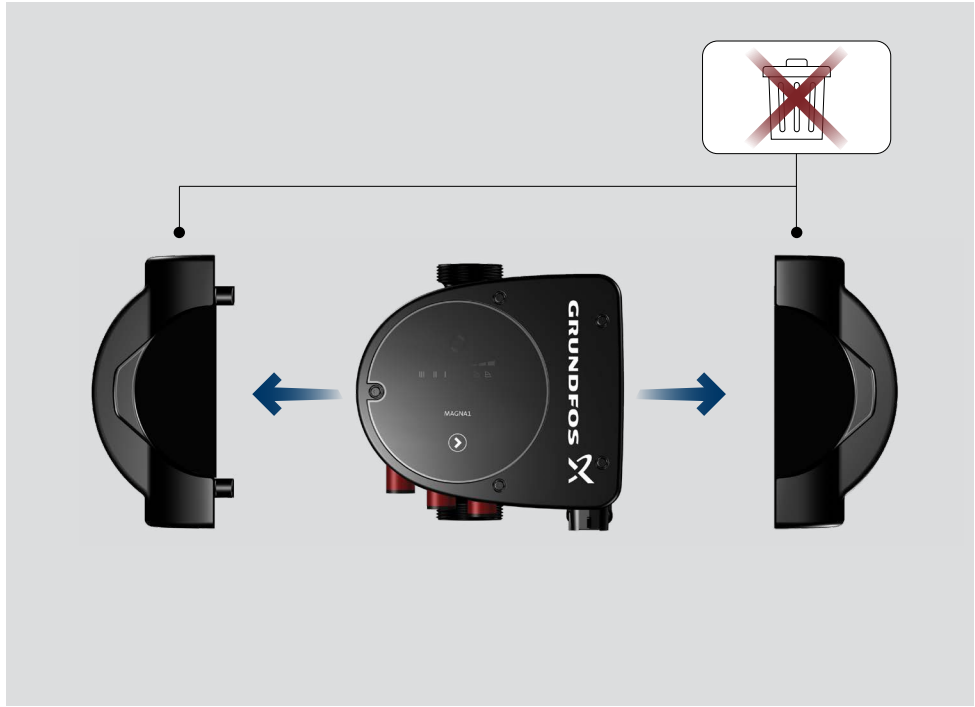



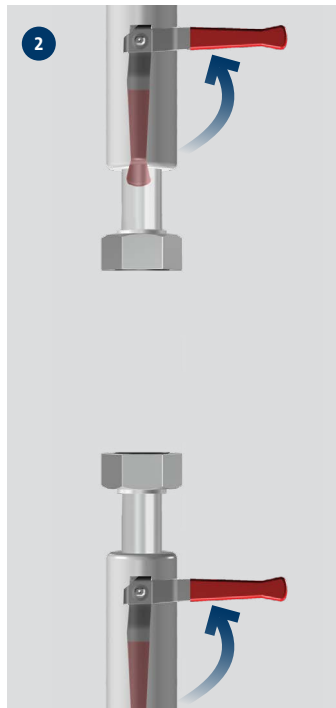


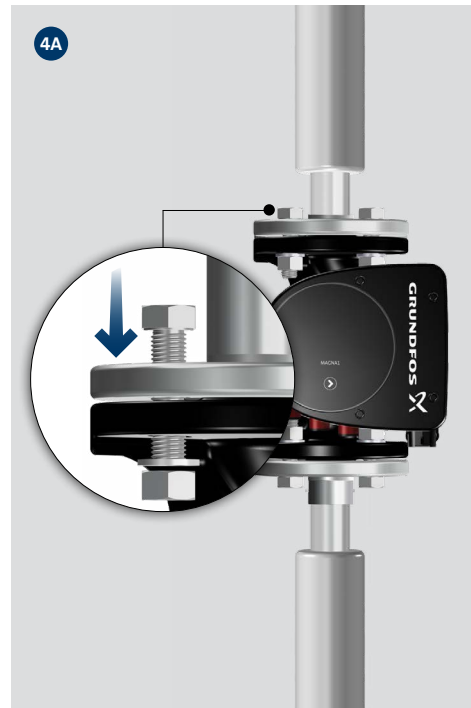

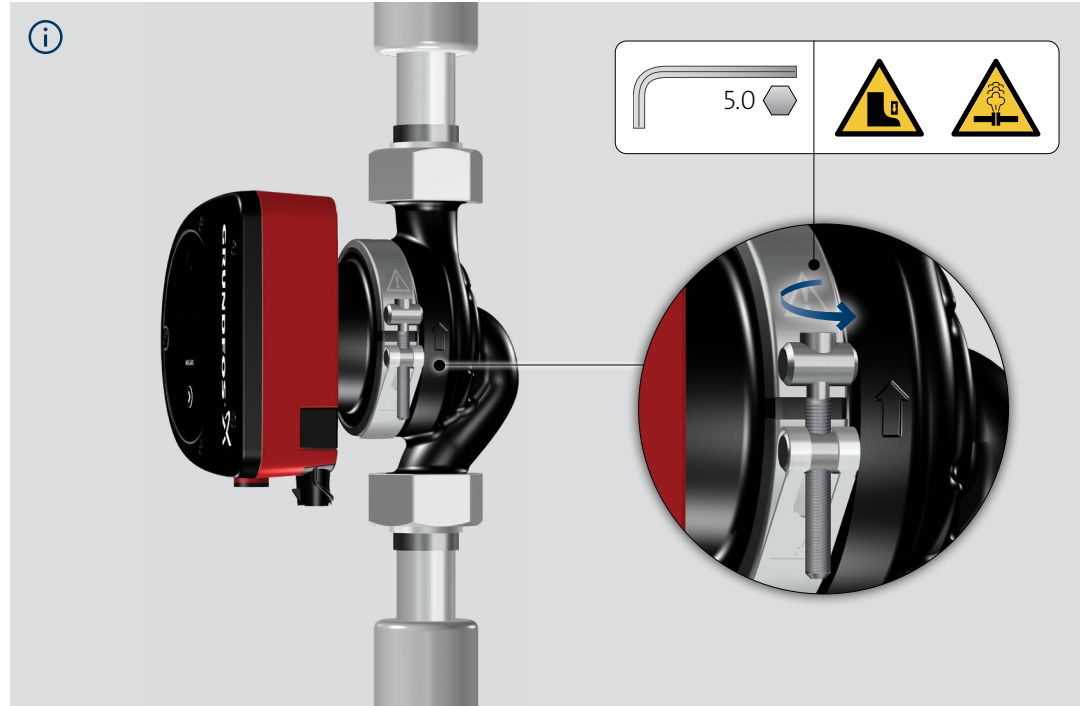

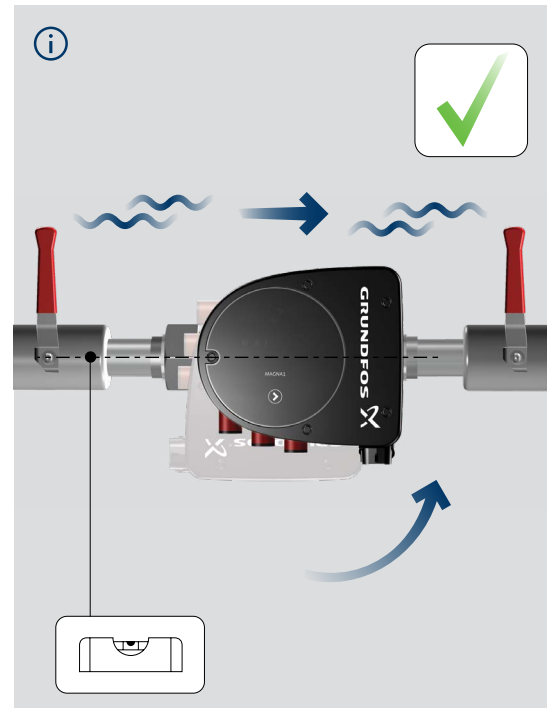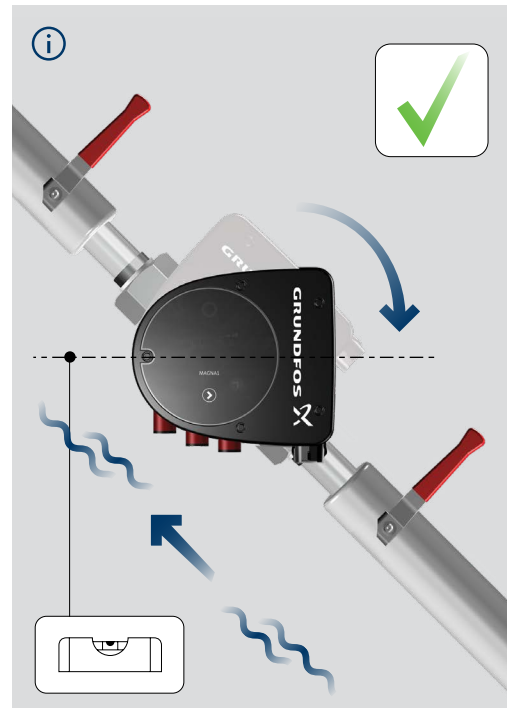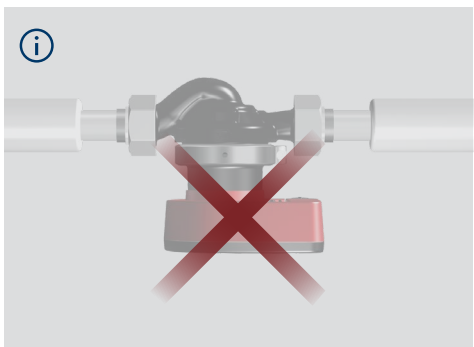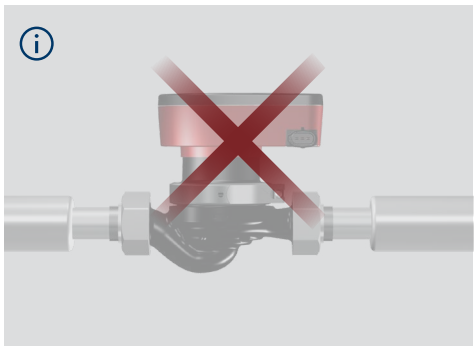


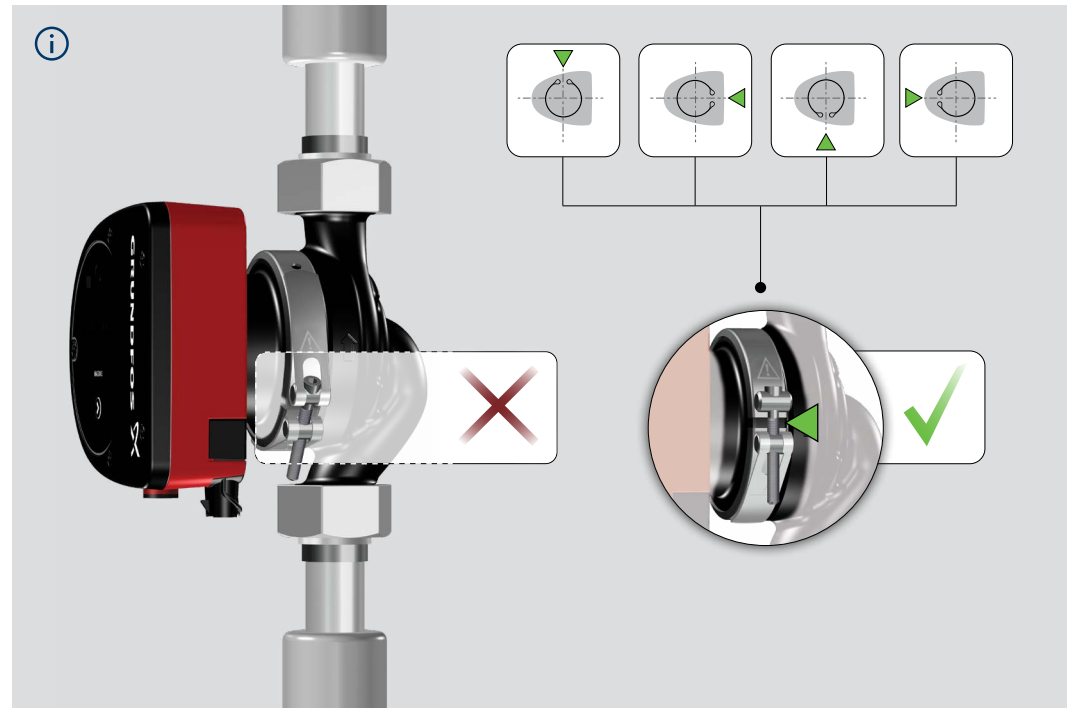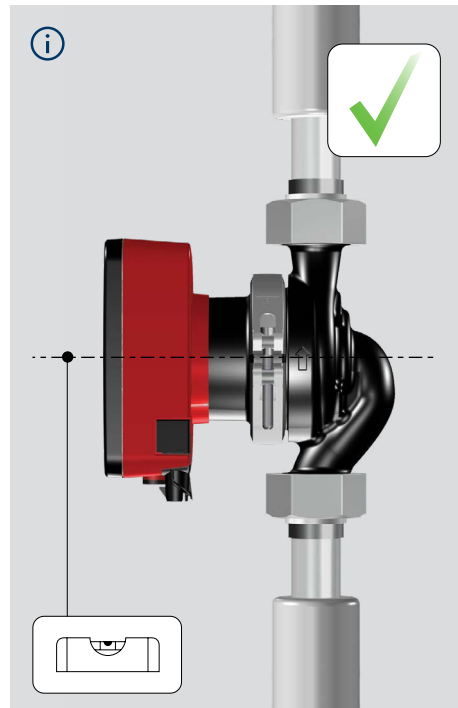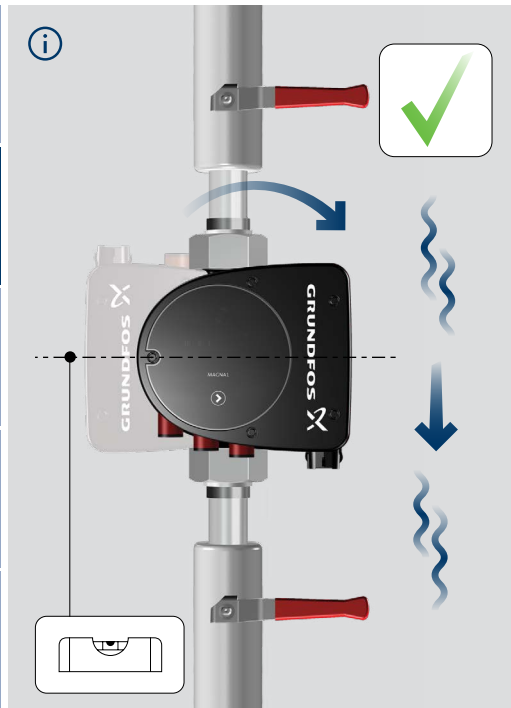


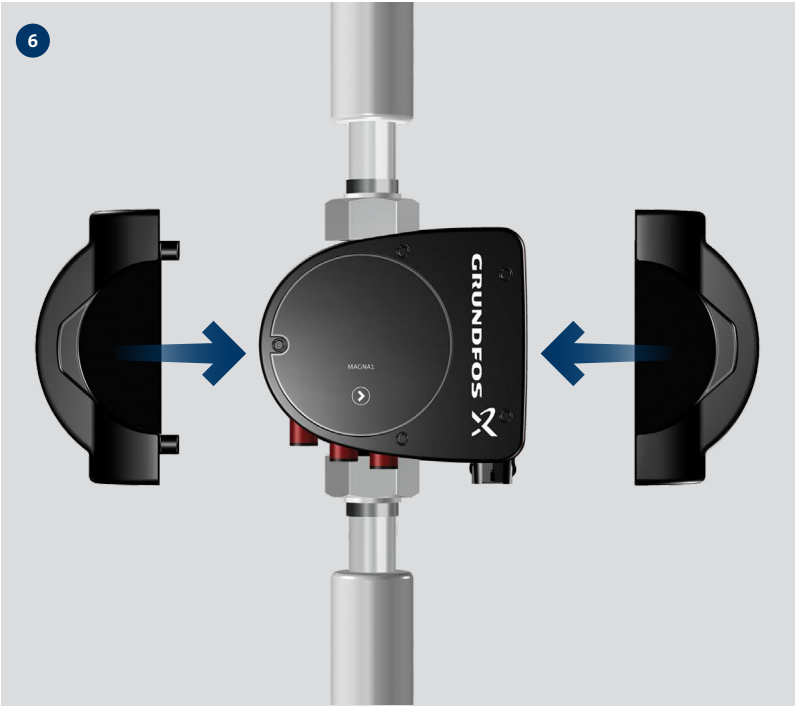
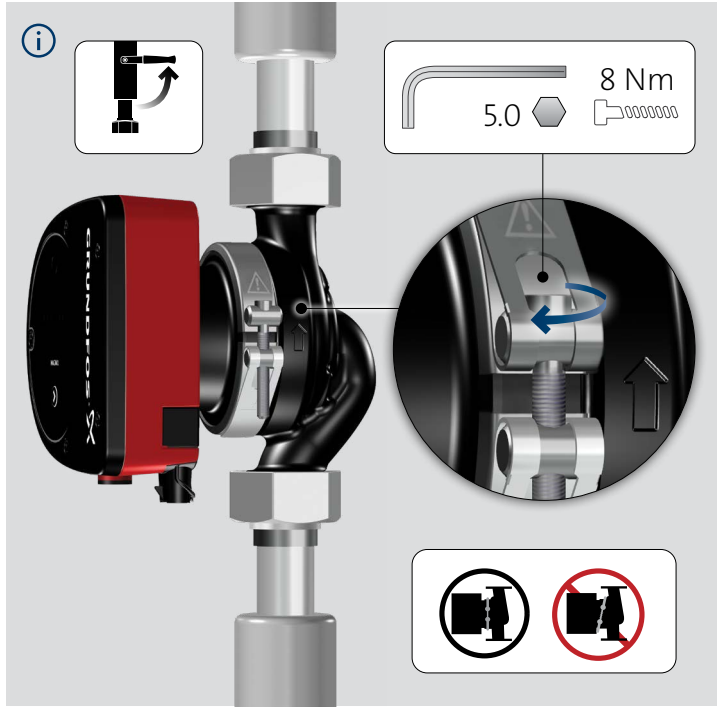




7

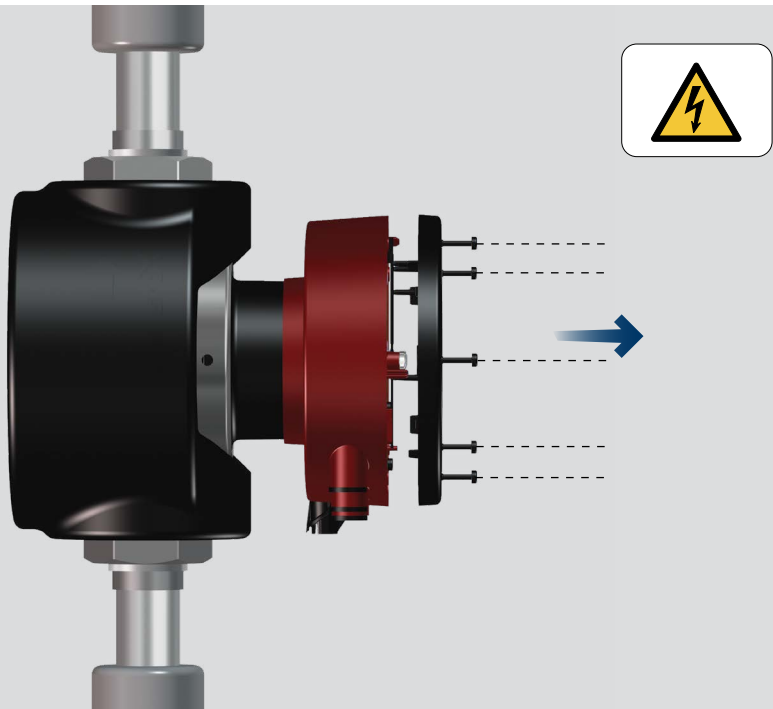


i

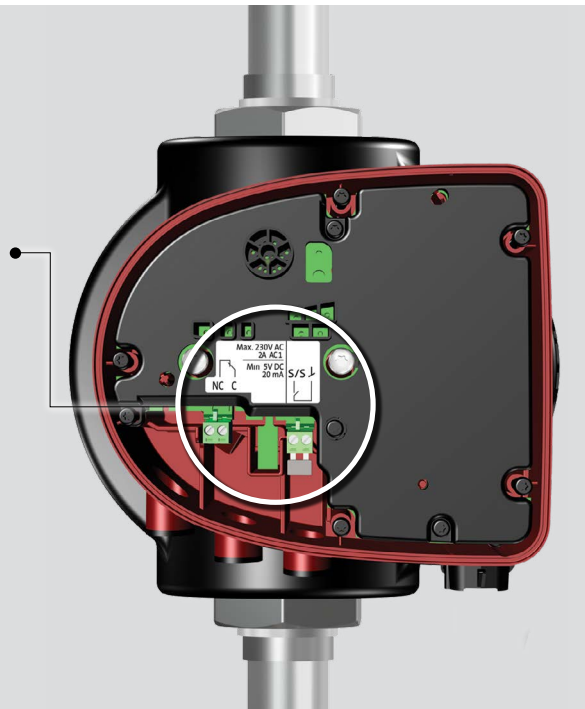




**Fault relay
output**











M16



**Start/stop
input**



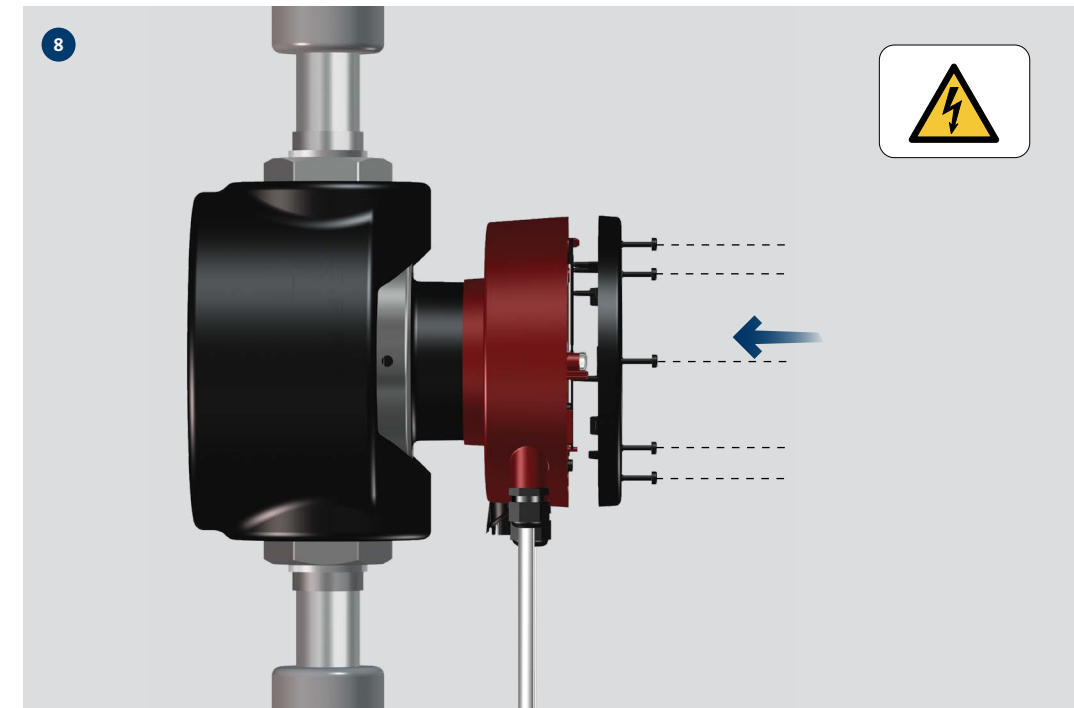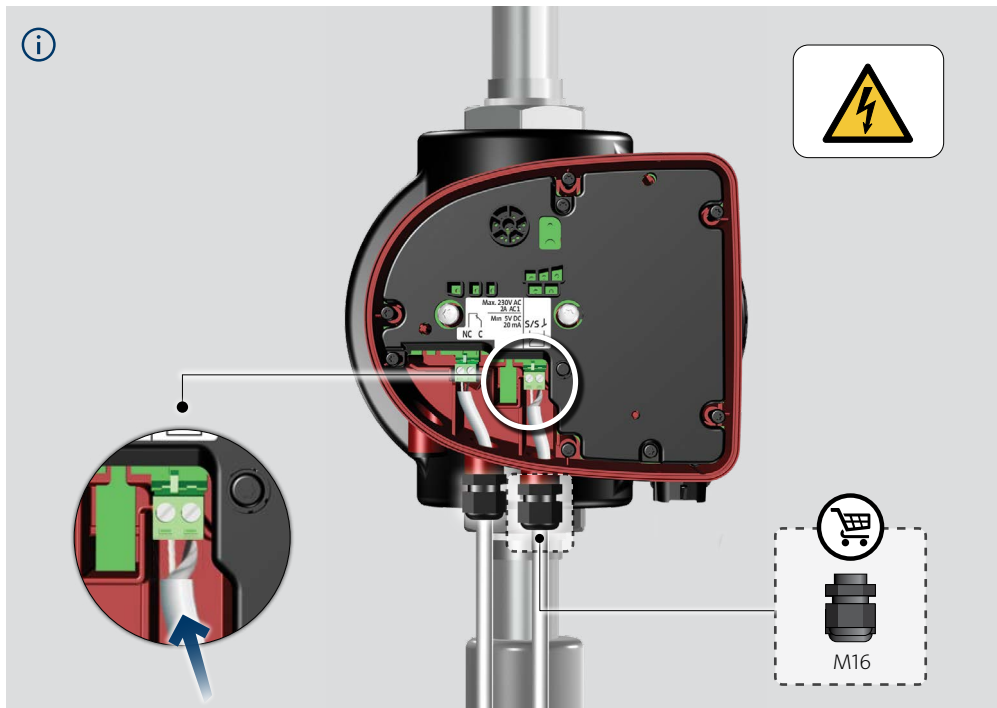

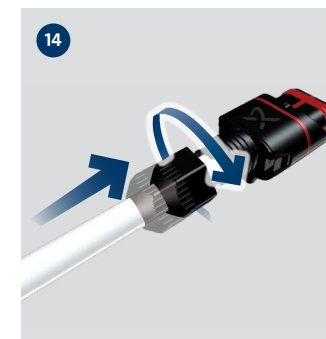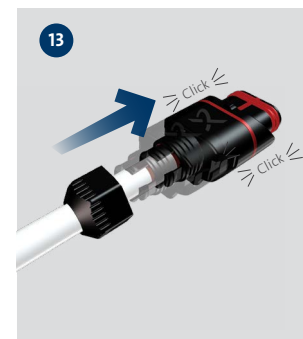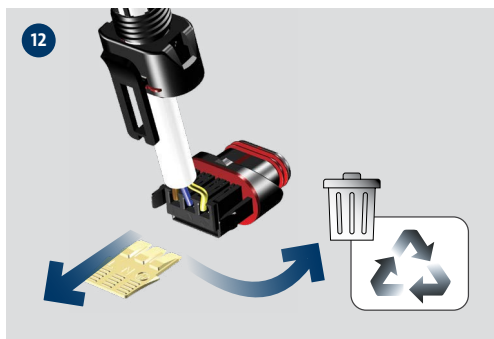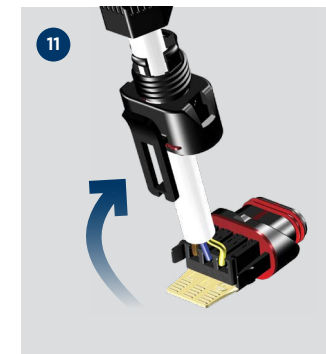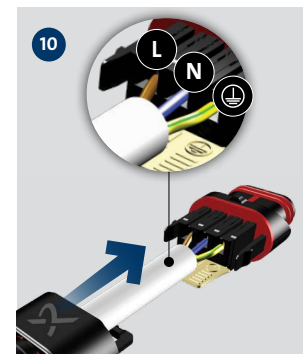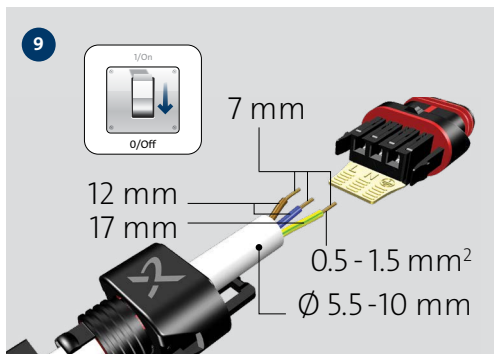







16



i

Power cycle
Max. 4 starts
per 60 minutes



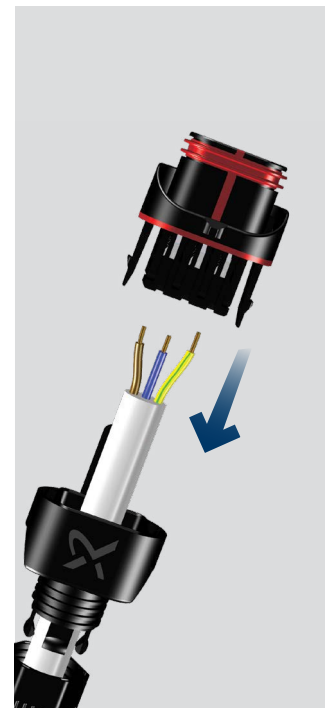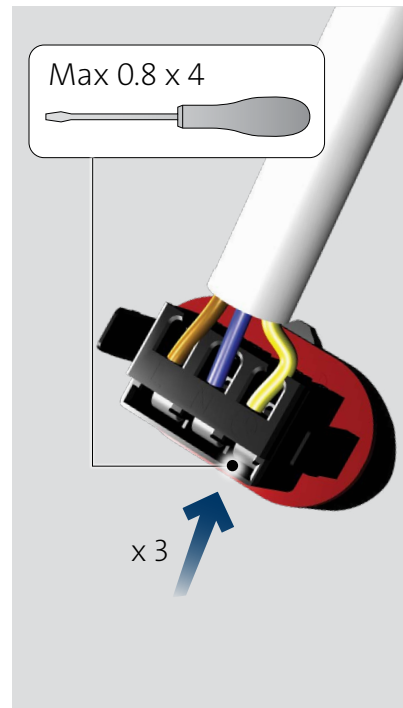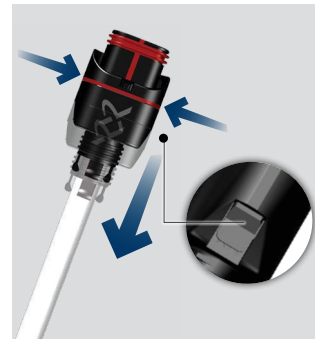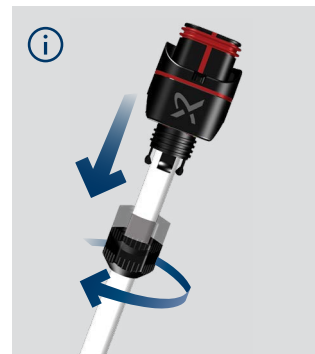





i

IR



IR

IR

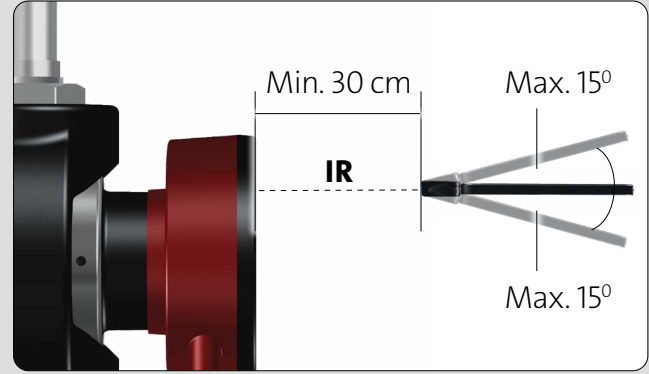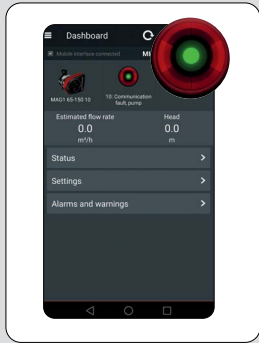


net.grundfos.com/qr/i/99209952



i




1X




2X




3X




4X



5X




6X





7X








8X



i

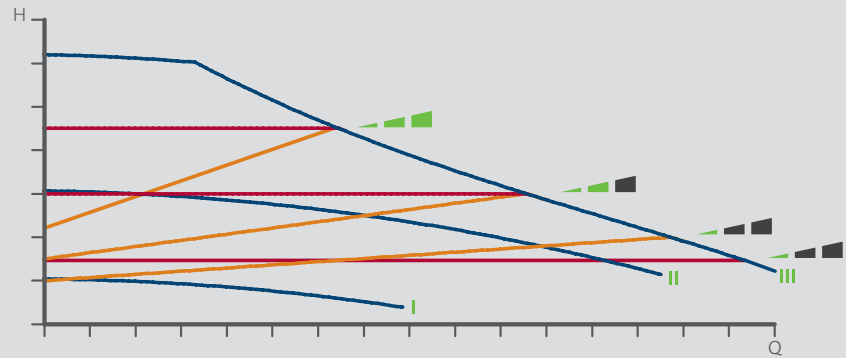

net.grundfos.com/qr/i/99209952

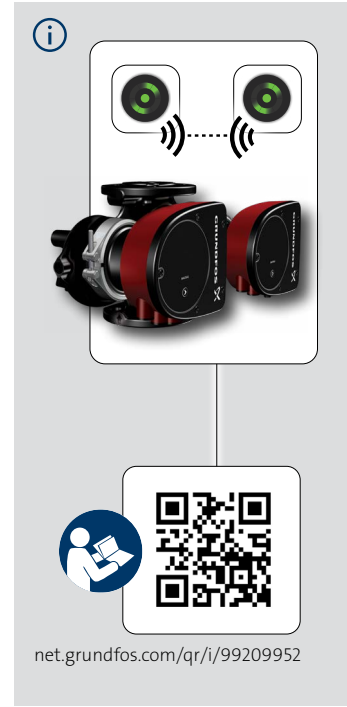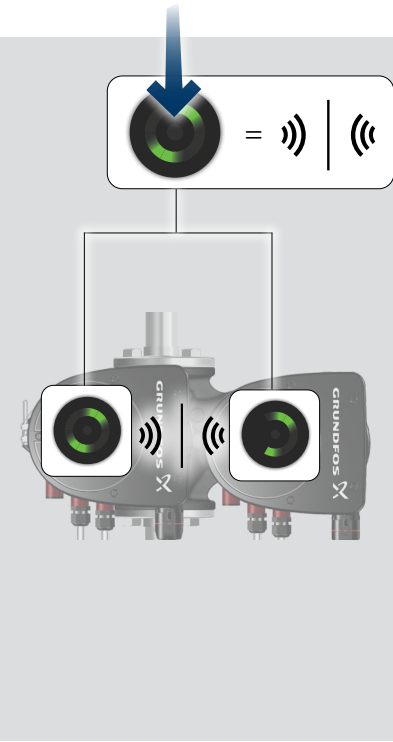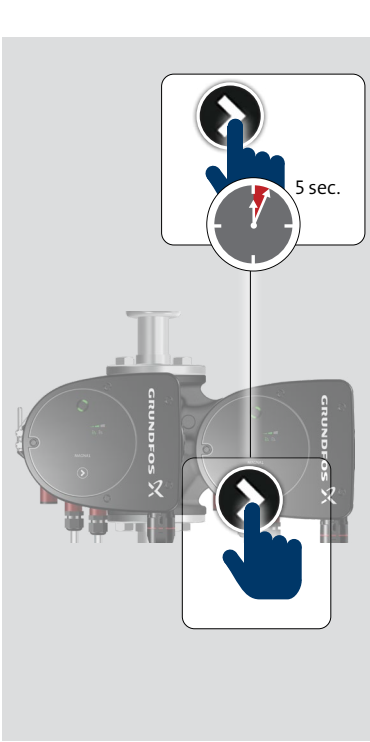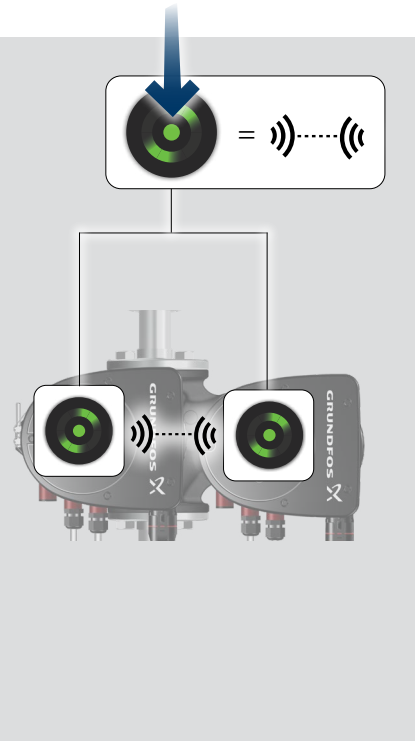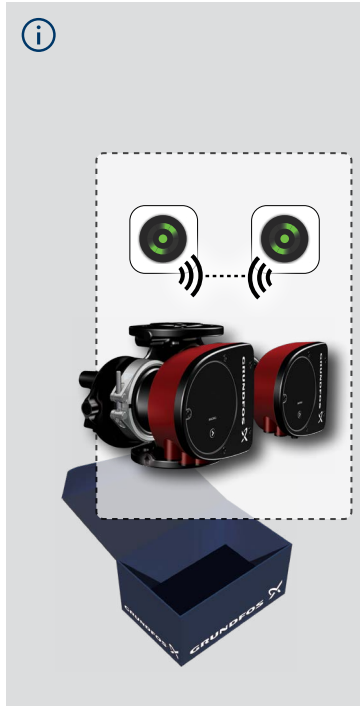

Installation date: _____

Installer:

99334333 07.2020

ECM: 1290169

GRUNDFOS Holding A/S
Poul Due Jensens Vej 7
DK-8850 Bjerringbro
Tel: +45 87 50 14 00
www.grundfos.com

GRUNDFOS 